


TYPICAL CROSS SECTION

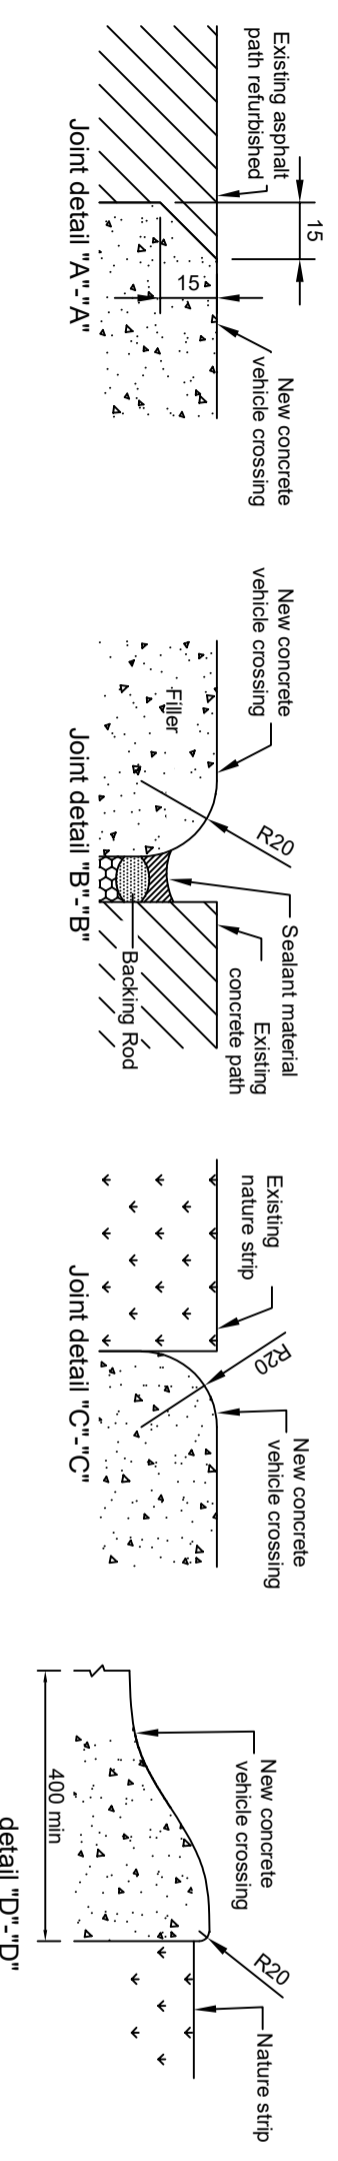

NOTES GENERAL

1. Bluestone channel shall be retained.
2. Concrete colour: Integral Charcoal 4.15%, by weight in grey cement. Other colours need to be approved by Council.
3. Finish shall be stipple trowel.
4. Tooling grooves to be approved by superintendent.
5. Bullnose may be required in some cases.

BLUESTONE CHANNELS

Bluestone channel to be relaid as per BCC 302. Crossing's concrete ends a invert. Built a straight edge by formwork and grout (charcoal mortar) to fill as grout the joint concrete / blue stone.

RESIDENTIAL CROSSINGS

Minimum 150mm depth concrete (strength shall be min. 25Mpa at 28 days).

COMMERCIAL/INDUSTRIAL CROSSINGS

Minimum 200mm depth concrete (strength shall be min. 32Mpa at 28 days) reinforced with F82 mesh top.

SEPARATOR ISLAND

1. Subject to Bayside City Council approval.
2. Not to be paved.
3. Width is between Back Of Kerbs.
4. In most cases, kerbs of entire separator shall be formed, with a saw cut in neighbouring crossing.



Approved

Date: 9-Apr-21

References to:

Scale
1:20, 1:50

Standard Drawing Title
Vehicle Crossing with Blue Stone Channel

Standard Drawing No.
BCC410

Rev: **A**

Sections